


THE PROPER PROCEDURES TO WASHING, RINSING AND SANITIZING EQUIPMENT AND UTENSILS

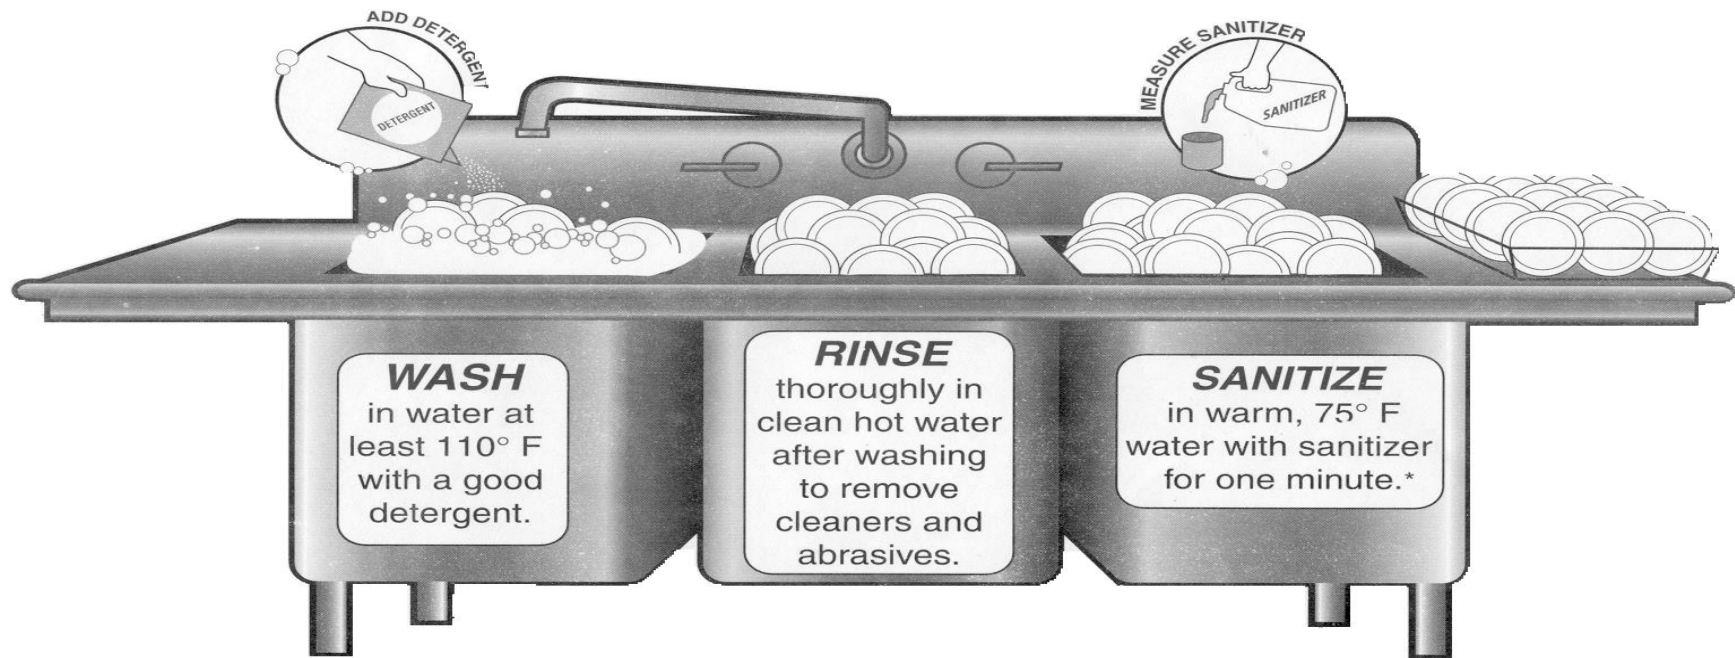

REMEMBER, EQUIPMENT AND UTENSILS CANNOT BE SANITIZED UNLESS THEY ARE PROPERLY CLEANED. Sanitize by completely immersing utensils for one minute in warm (75 degree F), rinse water containing at least 50 ppm available chlorine or 12.5 ppm available iodine. For quaternary ammonium sanitizers, use according to the directions on the container. The pH, temperature and hardness of the rinse water may affect the concentration and contact time required for the sanitizer. LET AIR DRY- Sanitizer contact time is important; do not towel dry.

Illinois Department of Public Health